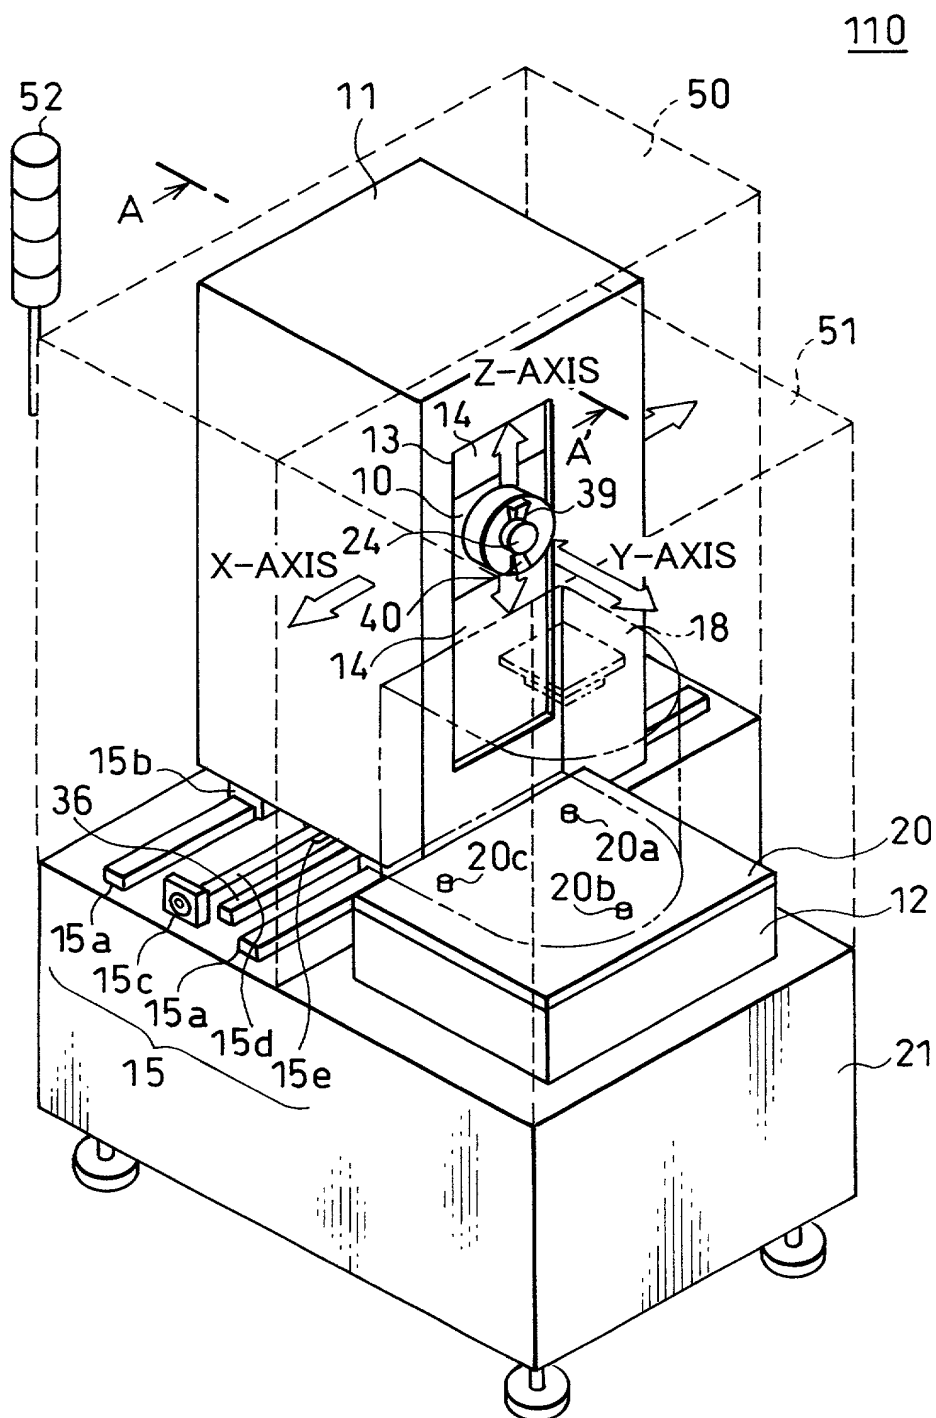


[illegible]


[illegible][illegible]

FIG.3

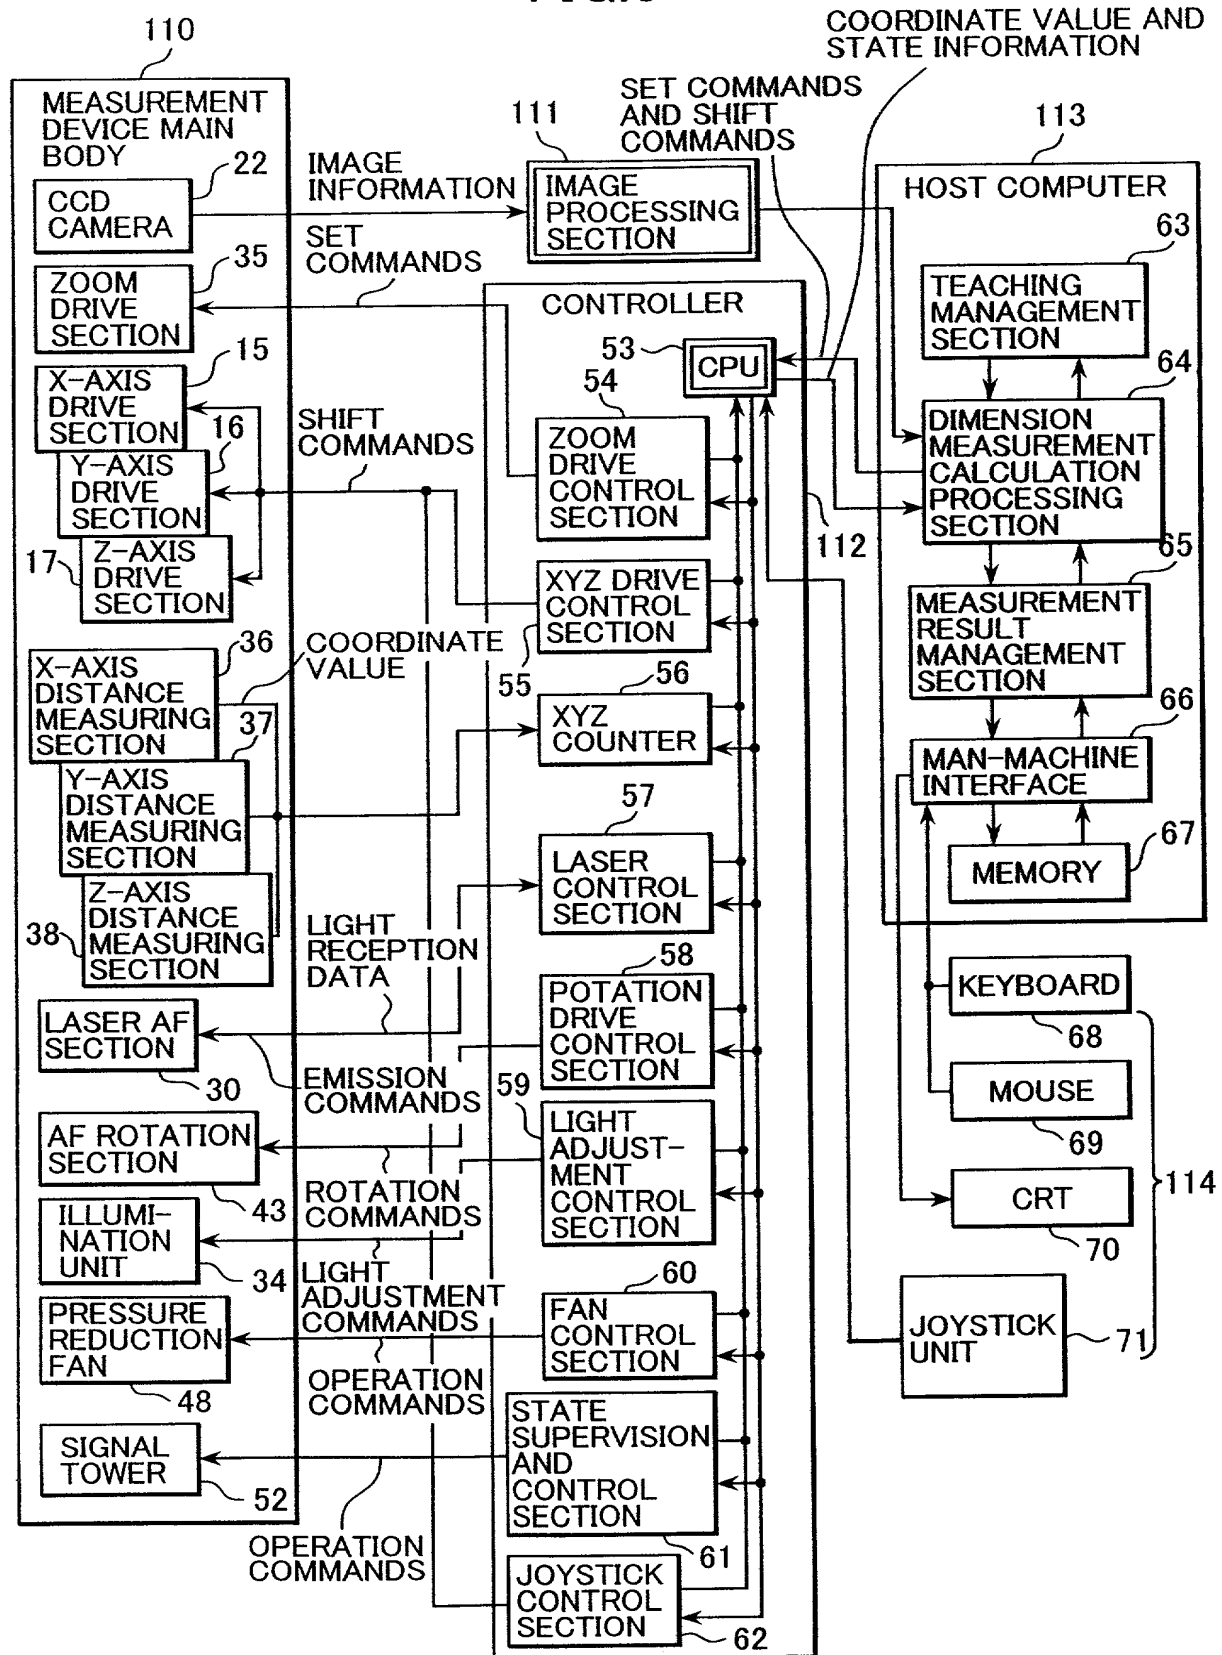


FIG.5A

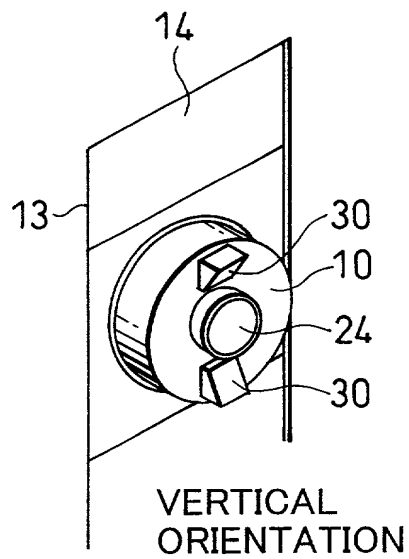


FIG.5B

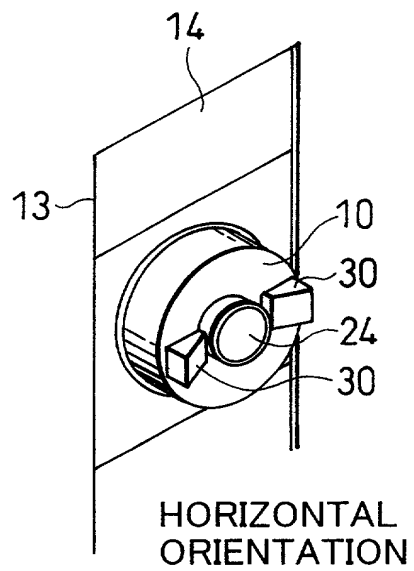


FIG. 6

B-B' SECTIONAL VIEW


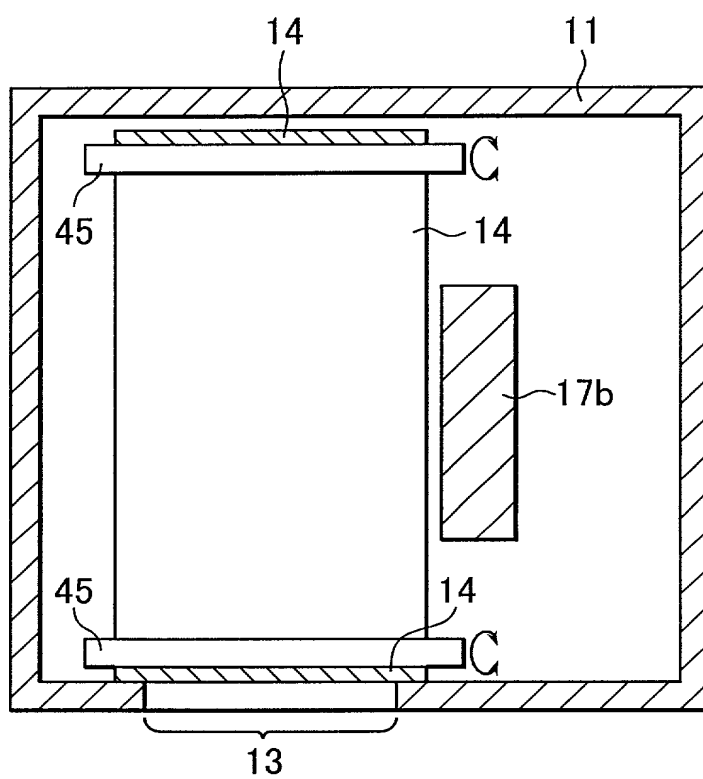


FIG.7

B-B' SECTIONAL VIEW
(WITH PRESSURE REDUCTION FAN 48 OPERATING)

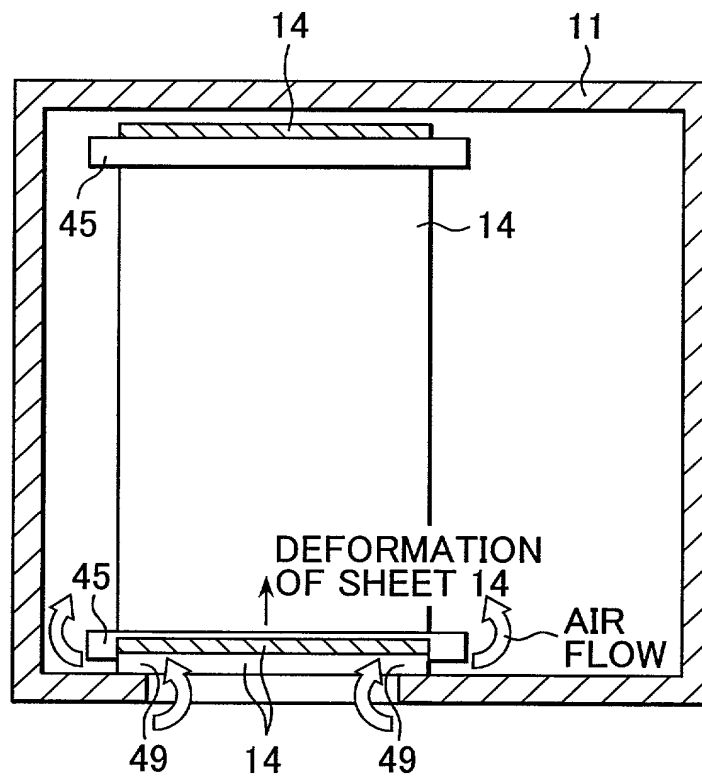

[illegible]

(WITH PRESSURE REDUCTION FAN 48 OPERATING)

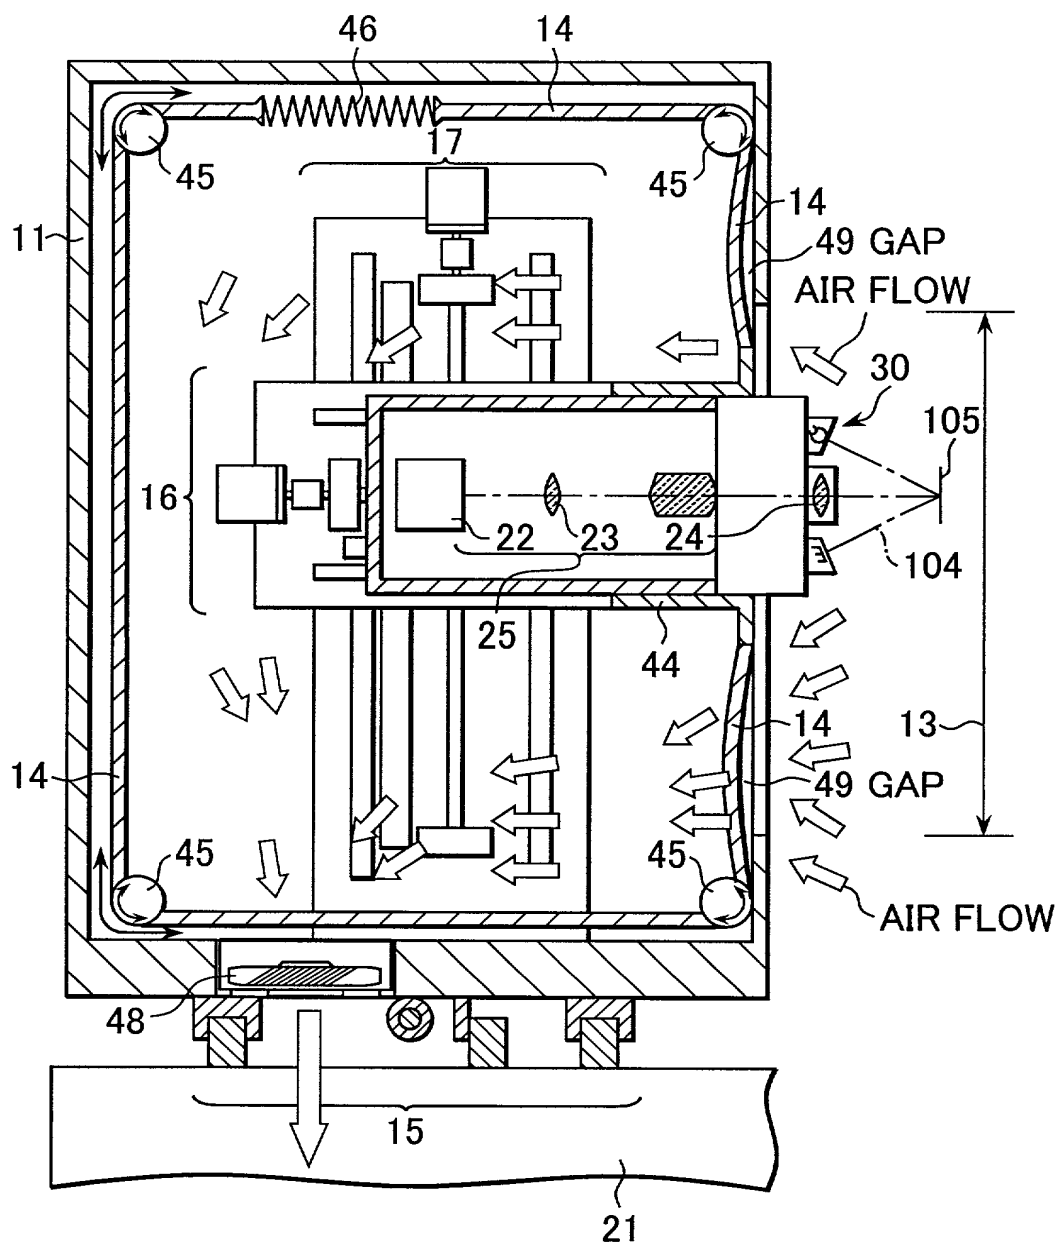


FIG.10

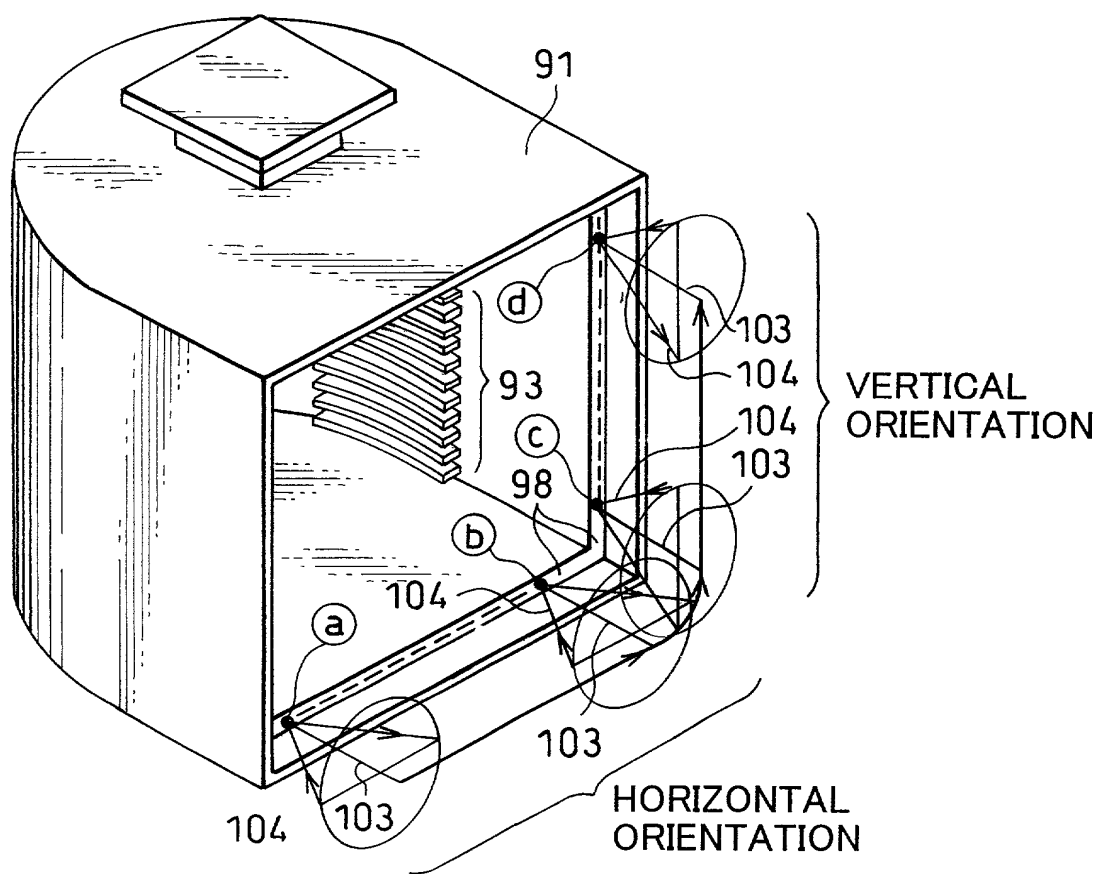


FIG.11

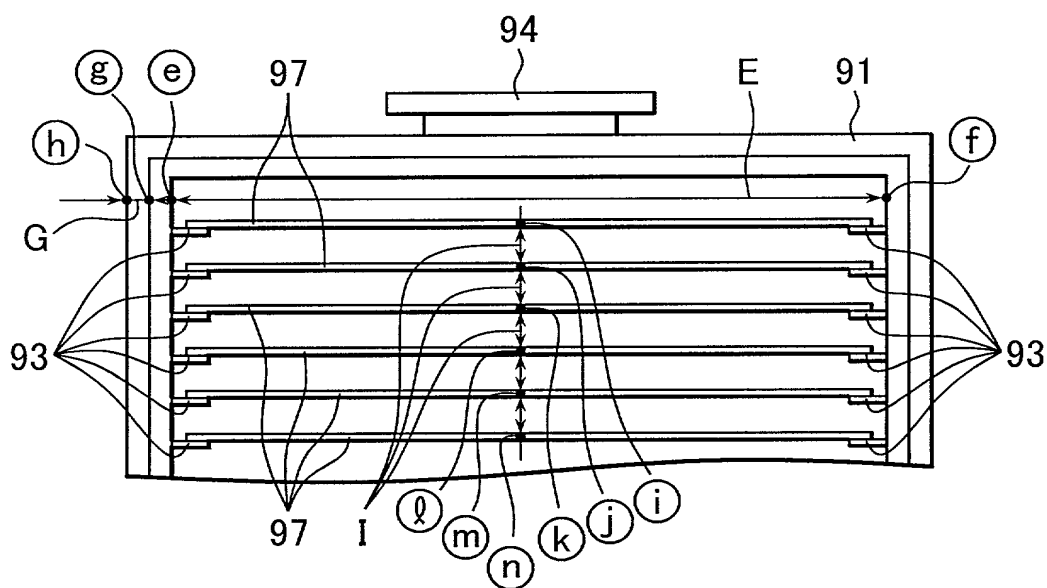


FIG.12

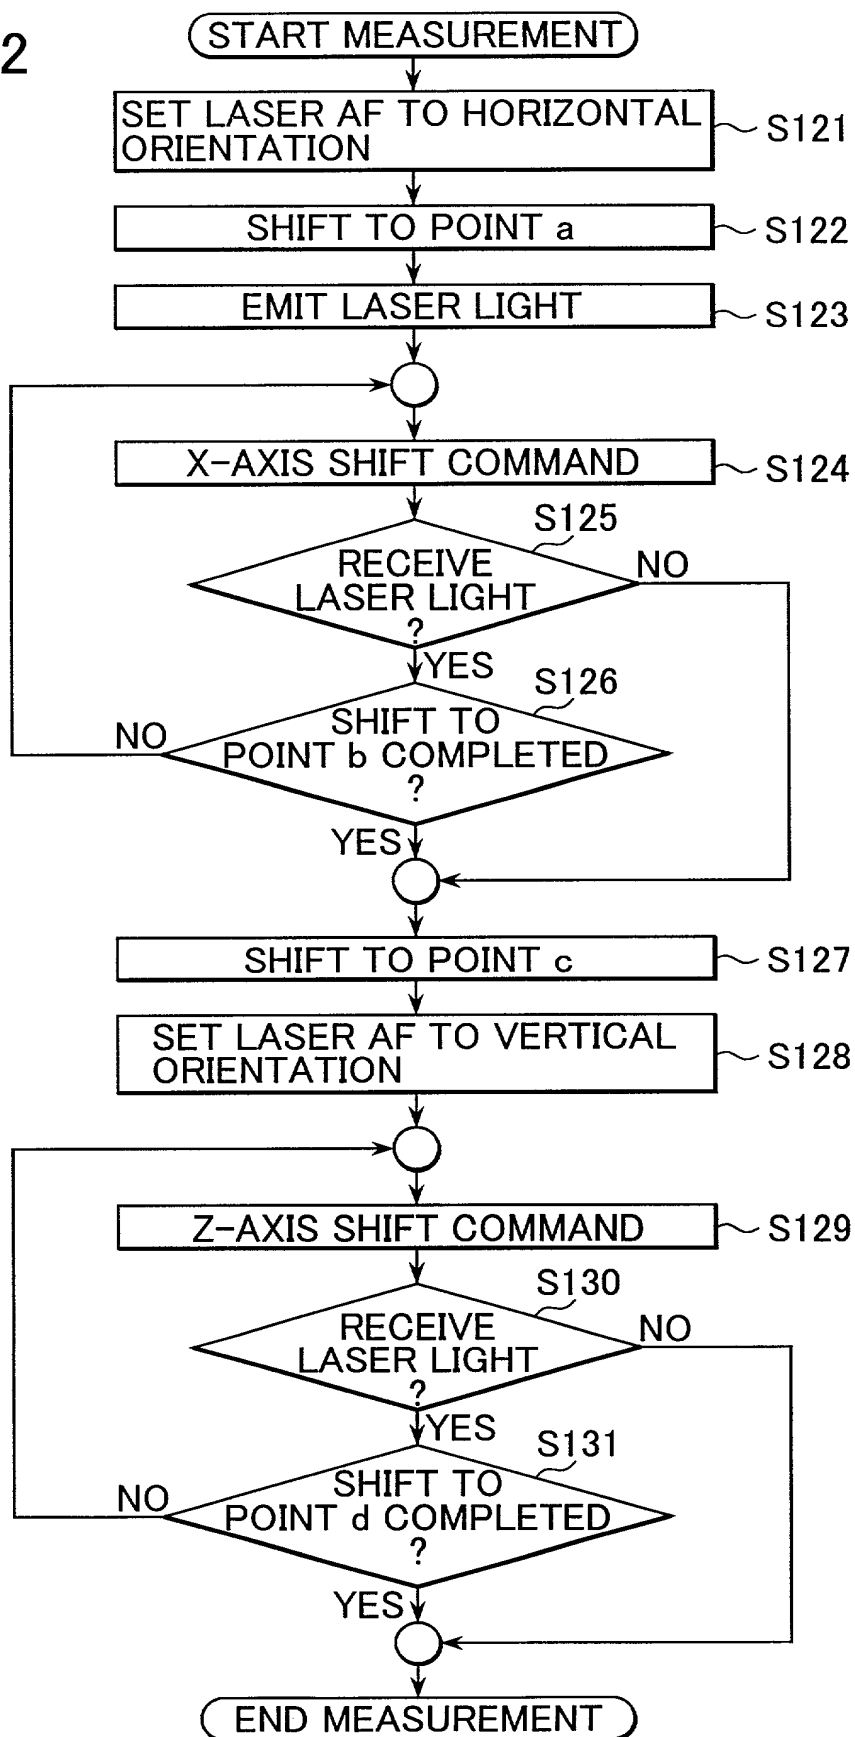


FIG.13A

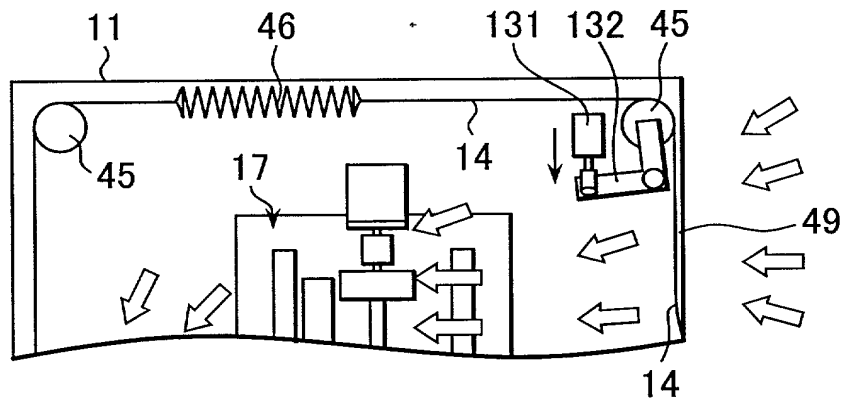


FIG.13B

